


BOOK 1154 PAGE 828

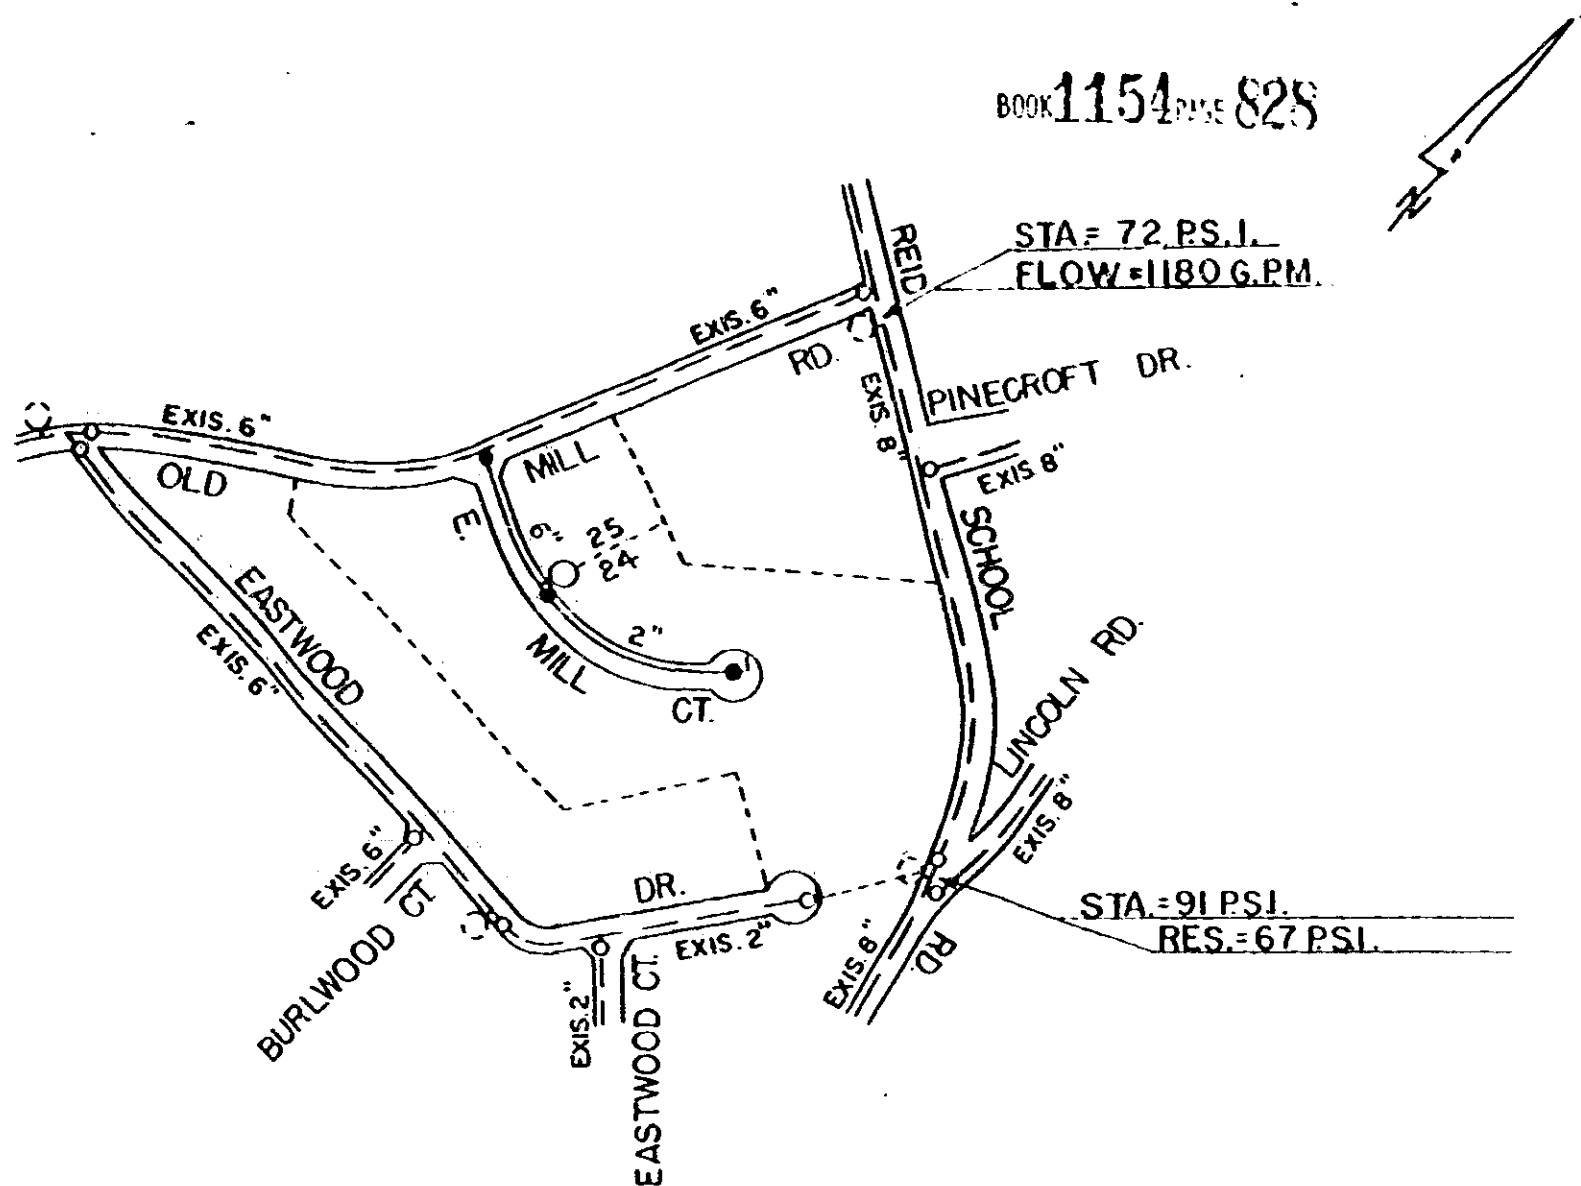

NOTE: 6" VALVES OPEN RIGHT, 2" VALVES OPEN LEFT, FIRE HYDRANT TO BE 3-WAY & OPEN RIGHT.

Material List:

6" D. I. Pipe	-	300' ±
2" Galv. Pipe	-	440' ±
6" Valves	-	2
2" Valves	-	2
Fire Hydrant	-	1

C. S. Willingham
to
Commissioners of Public Works
of the City of Greenville, S. C.
August 21, 1981
(BLK. BOOK T29.3-1-51)

OLD MILL ESTATES SEC. III
MAR 1981 SCALE: 1" = 400'

RECORDED SEP 10 1981 at 10:36 A.M.

6419

4328 RV-2