


STA. = 103 P.S.I.  
RES. = 40 P.S.I.

VOL 1177 PAGE 968

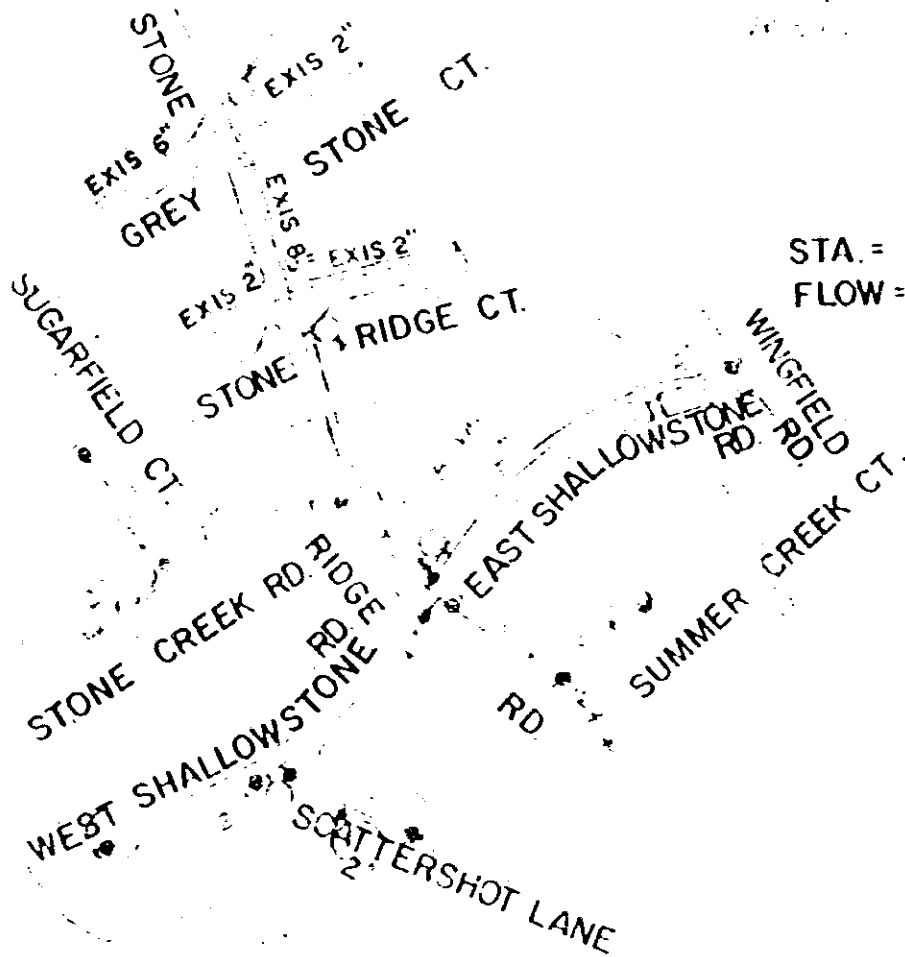

STA. = 115 P.S.I.  
FLOW = 1720 G.P.M.

NOTE: 6" & 8" VALS. OPEN RIGHT  
 2" VALS. OPEN LEFT  
 FIRE HYDS TO BE 3-WAY & OPEN RIGHT

MATERIAL LIST:

8" D. I. Pipe	-	1,180'±
6" D. I. Pipe	-	1,435'±
2" Galv. Pipe	-	1,340'±
8" Valve	-	1
6" Valves	-	6
2" Valves	-	12
Fire Hydrants	-	3
Valve Boxes	-	19

John C. Cothran Co., Inc.  
 Ellis L. Darby, Jr.  
 M. Graham Proffitt, III  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 November 9, 1982  
 Pt. of BLK. Book 534.2-1-16

SUGAR CREEK MAP I SEC. 3

APR. 1982 SCALE 1" = 400'  
REVISED NOV. 1982

12913

RECORDED NOV 29 1982 at 2:33 P.M.

096

4328 IV-2