


CHEROKEE FOREST

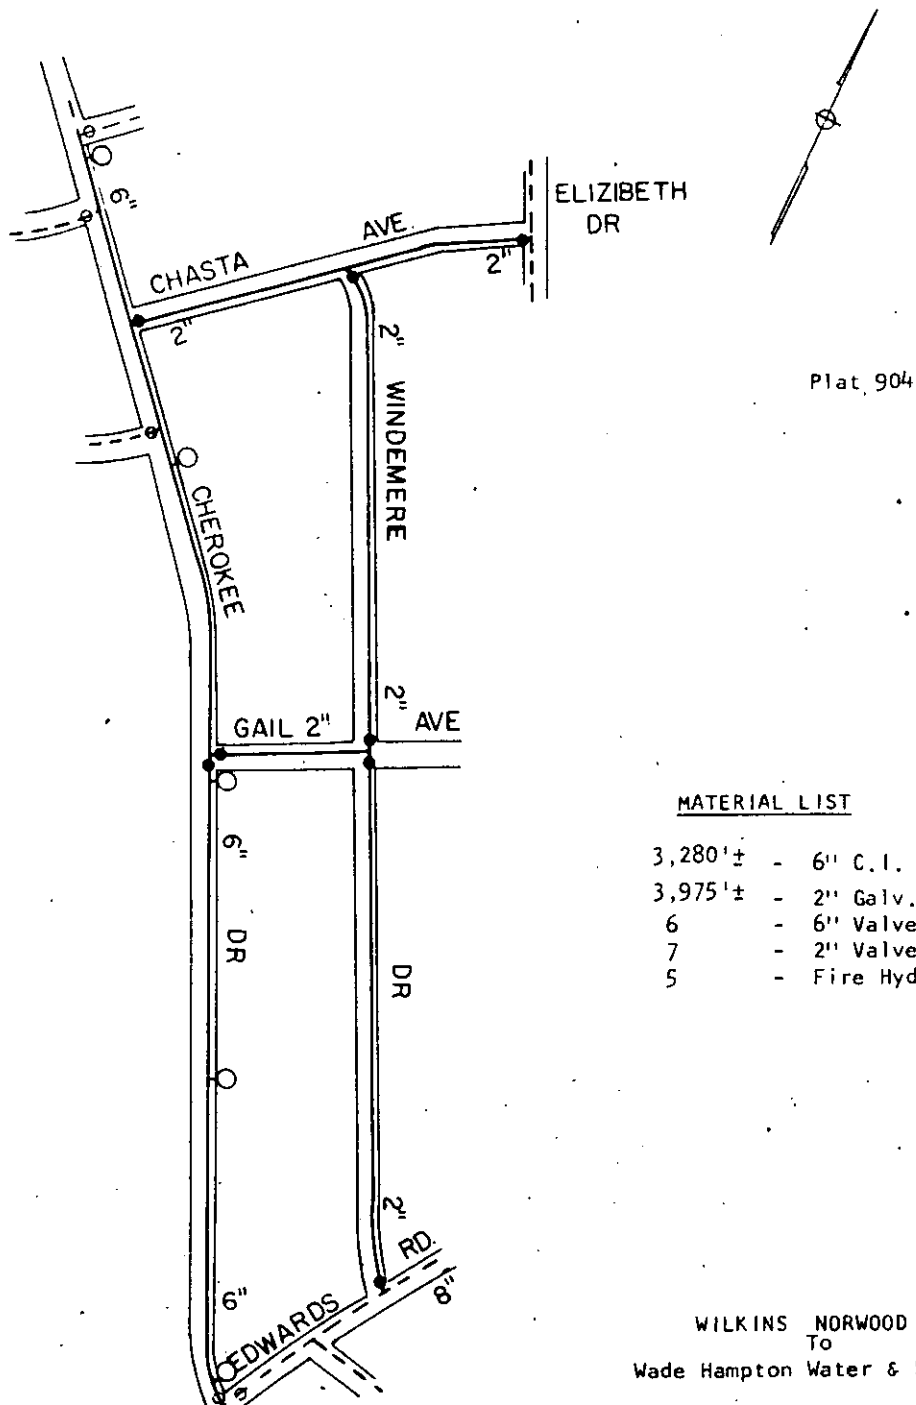

Plat. 904

MATERIAL LIST

- 3,280'± - 6" C.I. Pipe
- 3,975'± - 2" Galv. Pipe
- 6 - 6" Valves
- 7 - 2" Valves
- 5 - Fire Hydrants

WILKINS NORWOOD & CO.,
To
Wade Hampton Water & Sewer District

Scale 1" = 400', July 1968

Recorded December 31, 1968 At 4:56 P.M. # 15660