


LIBERTY PARK

PLAT 717

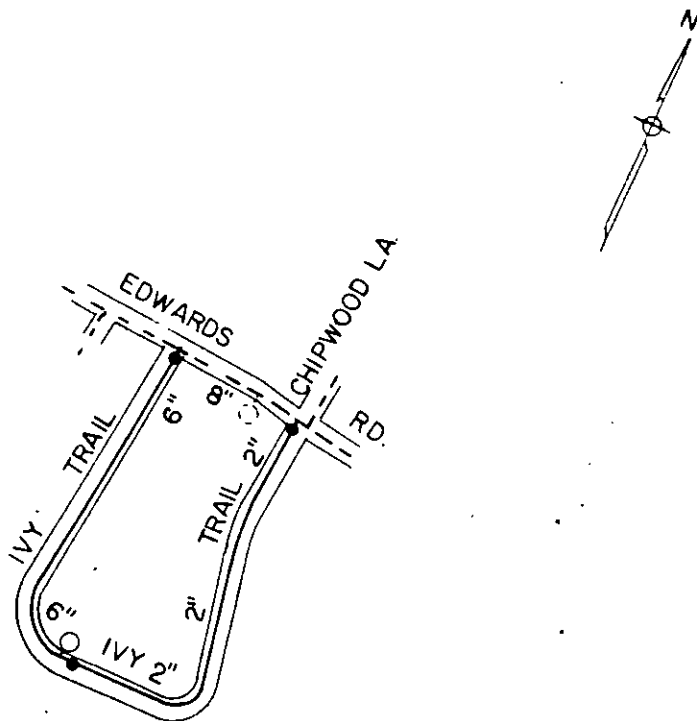

MATERIAL LIST

- 960'± - 6" C.I. Pipe
- 1,040'± - 2" Galv. Pipe
- 2 - 6" Valves
- 2 - 2" Valves
- 1 - Fire Hydrant

J. Henry Sitton
To
Wade Hampton Water & Sewer District

Scale 1" = 400', June 1968

*2815 Wade Hampton Blvd.
Taylor, S.C.*

Recorded December 31, 1968 At 4:55 P.M. # 15656