


0742

BOOK 1009 PAGE 242

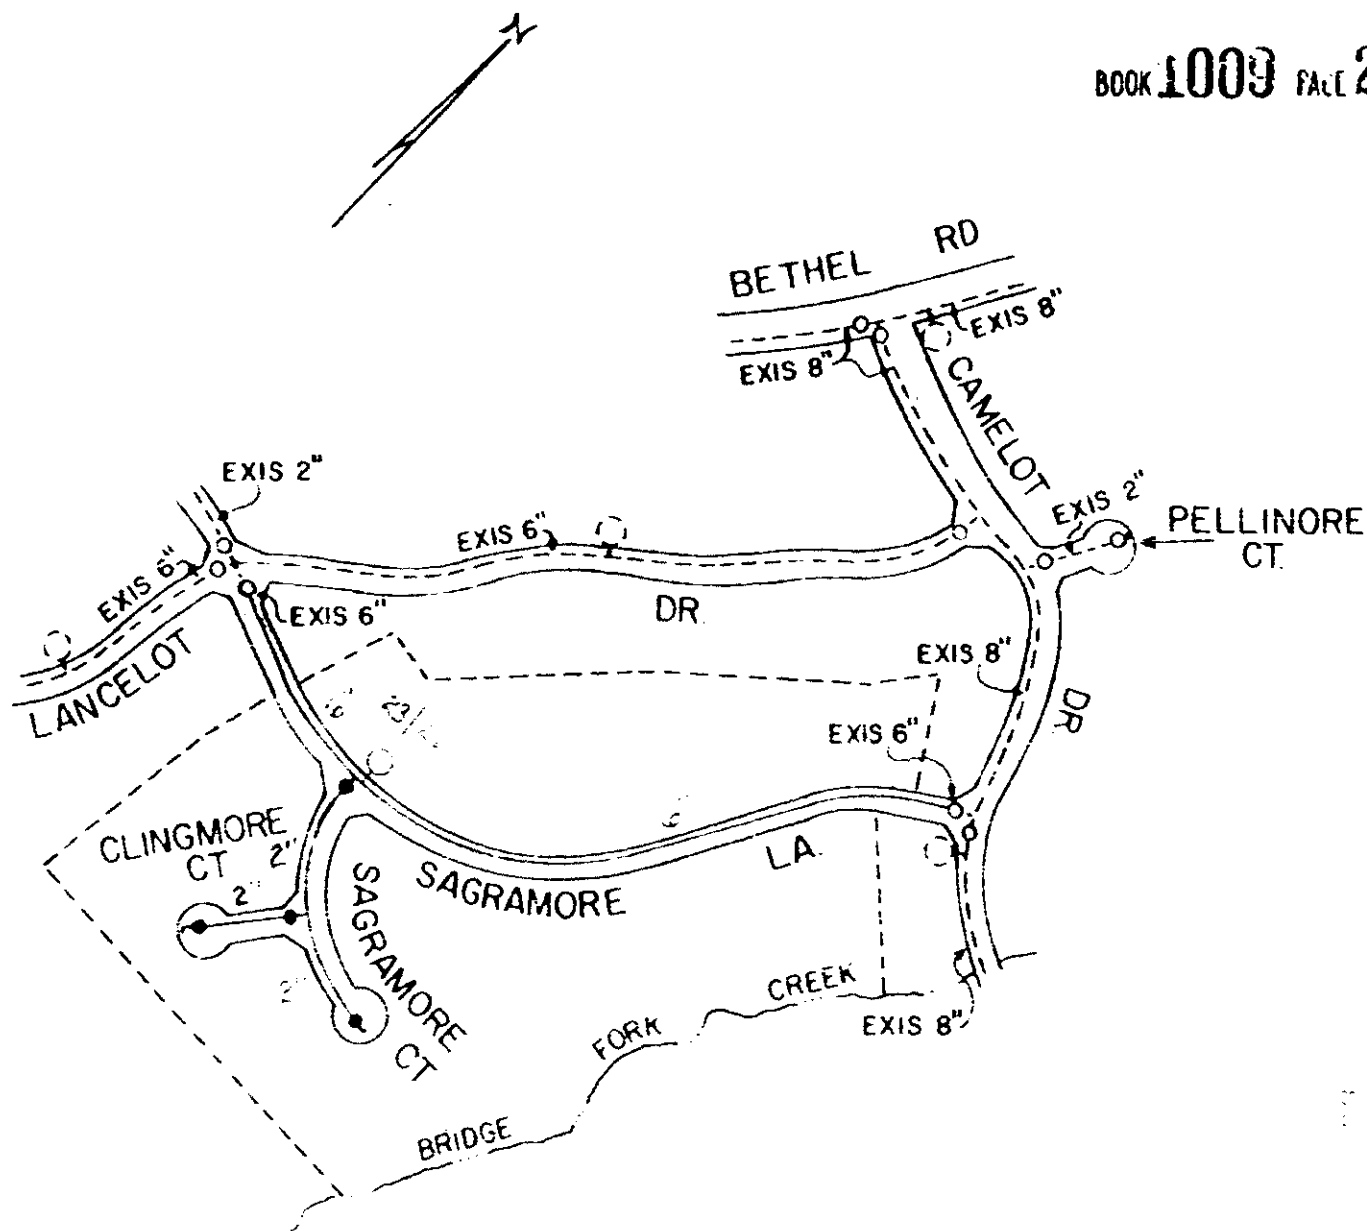

NOTE
 ALL 6" VALS & FIRE HYDS OPEN RIGHT
 ALL 2" VALS OPEN LEFT

Material List.

6" C. I. Pipe	-	1,510'
2" C. I. Pipe	-	750'
6" Valve	-	1
2" Valves	-	4
Fire Hydrant	-	1

Carroll, Inc.
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 September 23, 1974
 B.P. 8, 542.3-1-79

HOLLY TREE PLANTATION SEC. 3

MAY, 1974 SCALE = 400'

RECORDED OCT 25 '74

10804

4328 IV-2