


NOTE: ALL 2" VALVES OPEN LEFT
 ALL 6" & 8" VALVES OPEN RIGHT
 ALL FIRE HYDS. TO BE 3-WAY & OPEN RIGHT

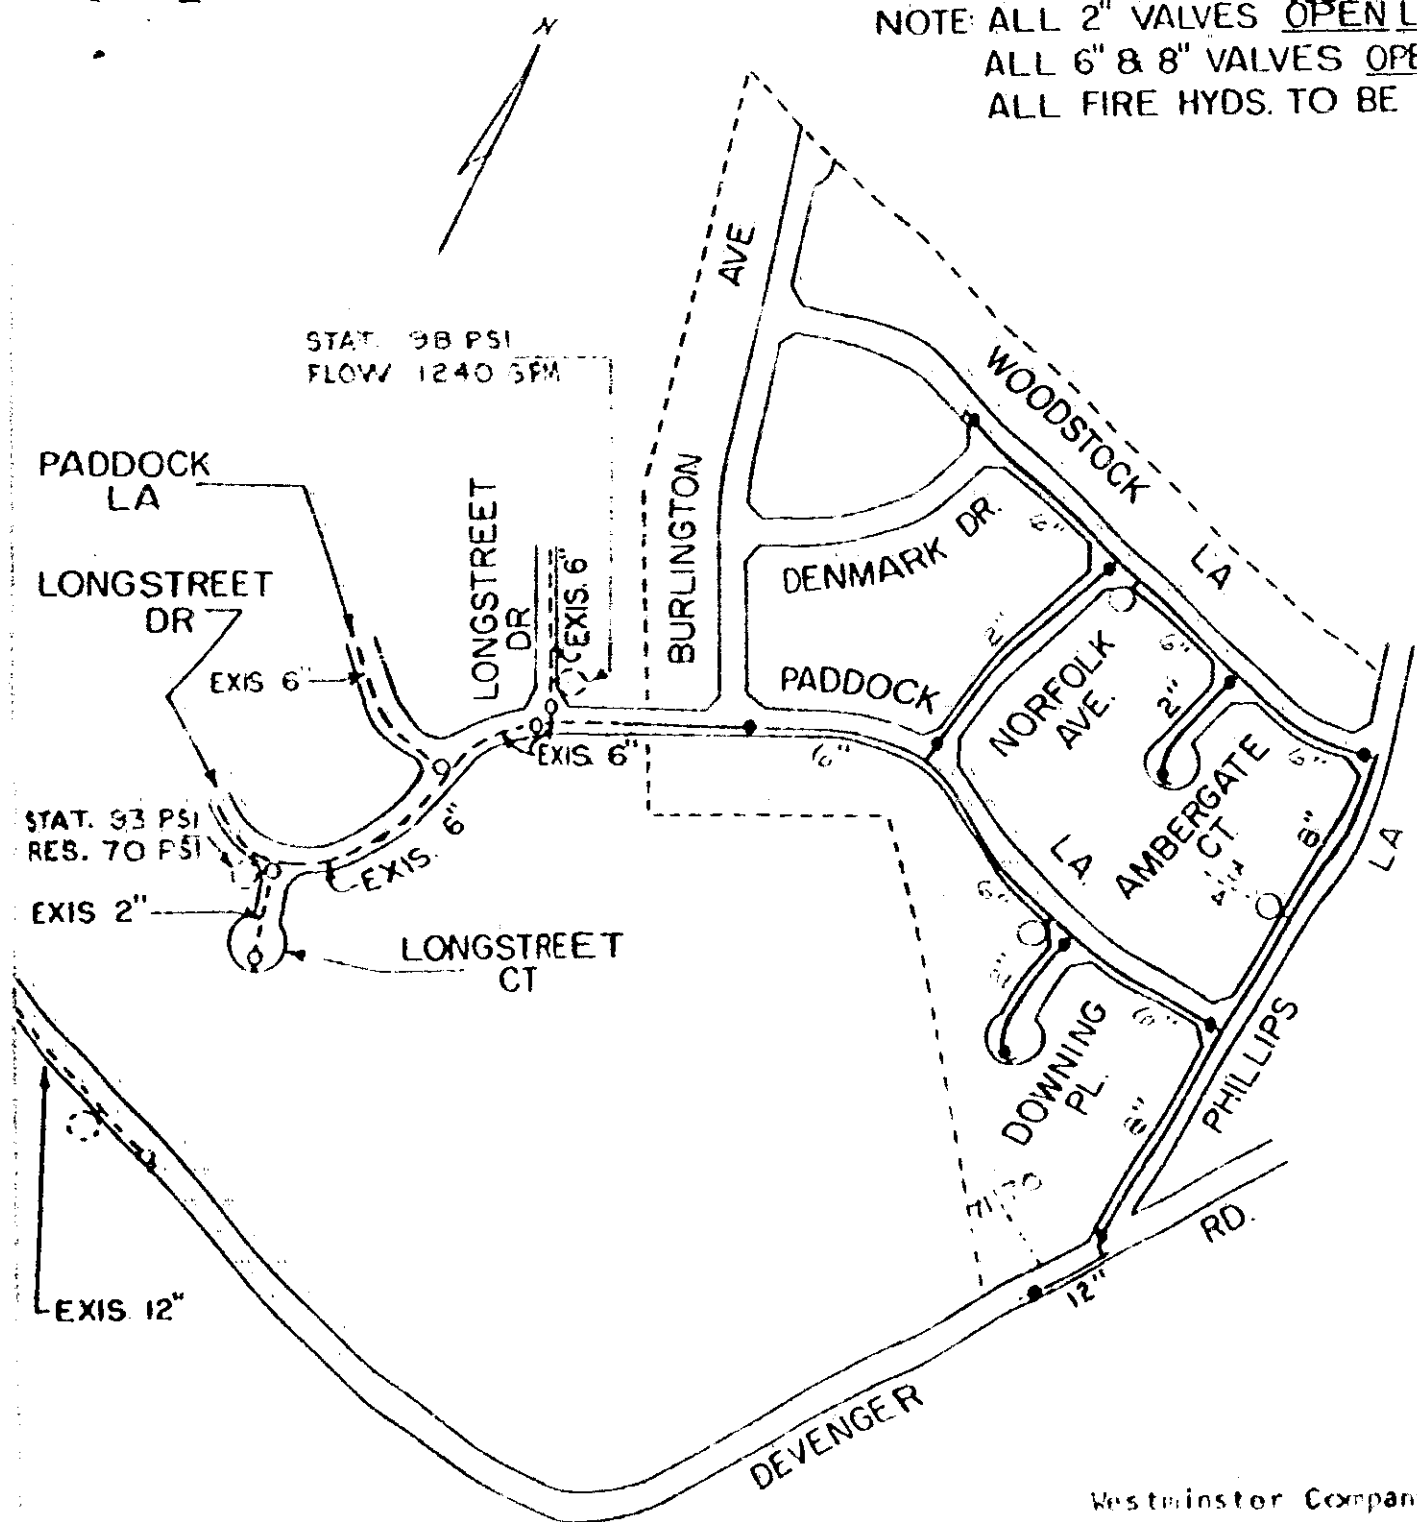

Material List:

12" D. I. Pipe	130'±
8" C. I. Pipe	1,065'±
6" C. I. Pipe	2,375'±
2" Galv. Pipe	1,050'±
8" Valve	1
6" Valves	6
2" Valves	8
Fire Hydrants	3

Westminster Company
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 August 16, 1976

WESTMINSTER VILLAGE, SEC. 1
 FEBRUARY, 1976 SCALE: 1" = 400'
 BLK. BK. 540.3-1-24

RECORDED SEP 1 '76 At 4:28 P.M.

6203

4328 RV-2

6
 0.32
 0.