


0130

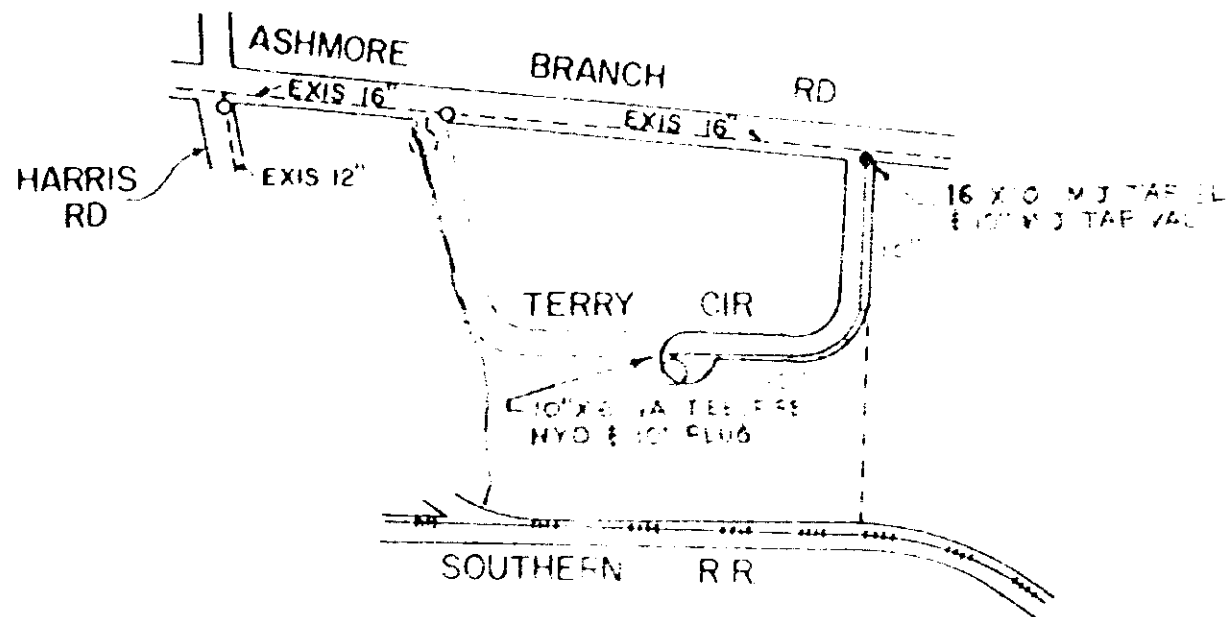

NOTE: ALL VALVES OPEN RT.
F. HYD. TO BE 3-WAY &
OPEN RT.

Material List

| | | |
|----------------|---|-------------------|
| 10" C. I. Pipe | - | 686' [±] |
| 6" C. I. Pipe | - | 10' [±] |
| 10" Valve | - | 1 |
| 6" Valve | - | 1 |
| Fire Hydrant | - | 1 |

S. DONALDSON WAREHOUSE DEV.

MAY 1974 SCALE 1"=400'
BLK BK 593 4-1-13

Terry Properties
to
Commissioners of Public Works
of the City of Greenville, S. C.
June 5, 1974

RECORDED JUN 13 '74

31852

4328 RV-2