


0450

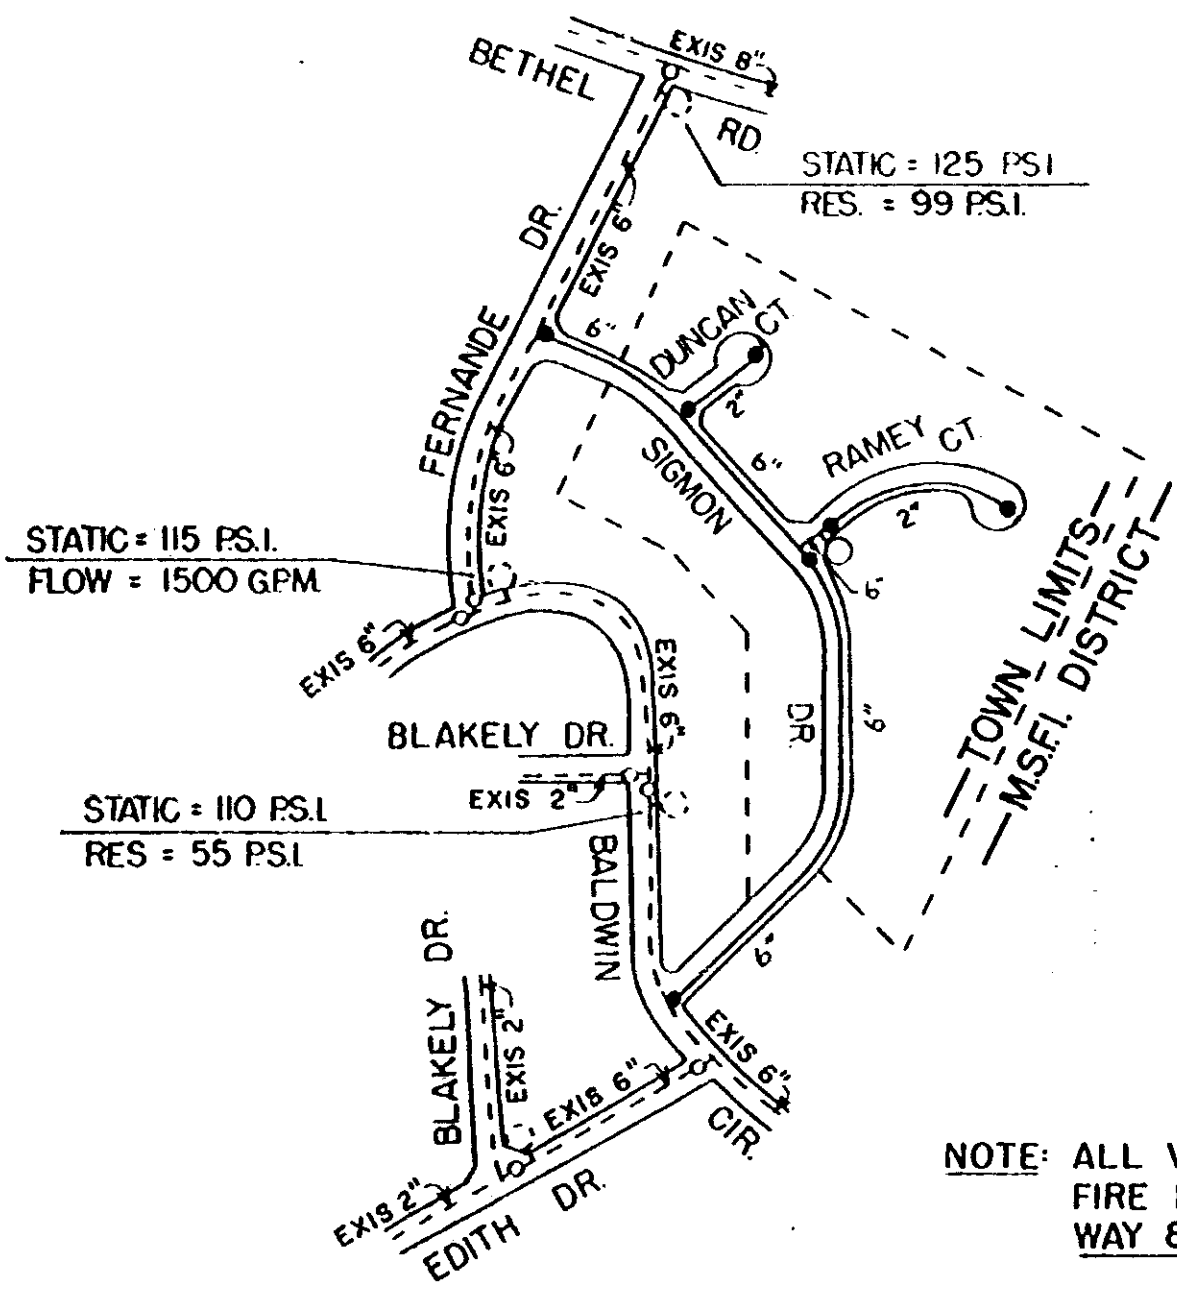

NOTE: ALL VALVES OPEN LEFT  
FIRE HYDRANTS TO BE 3-  
WAY & OPEN LEFT

**Material List:**

6" D. I. Pipe	-	1,754'±
2" Galv. Pipe	-	600'±
6" Gate Valves	-	4
2" Gate Valves	-	4
Fire Hydrant	-	1
Valve Boxes	-	8

OK ✓

**VERDIN ESTATES MAP III**  
OCT, 1979 SCALE: 1" = 400'

Westminster Company  
to  
Commissioners of Public Works  
of the City of Greenville, S. C.  
April 3, 1980  
Block Book 290-1-13

RECORDED APR 22 1980 at 4:00 P.M.

31172

4328 RV-2