


0 9 7 9

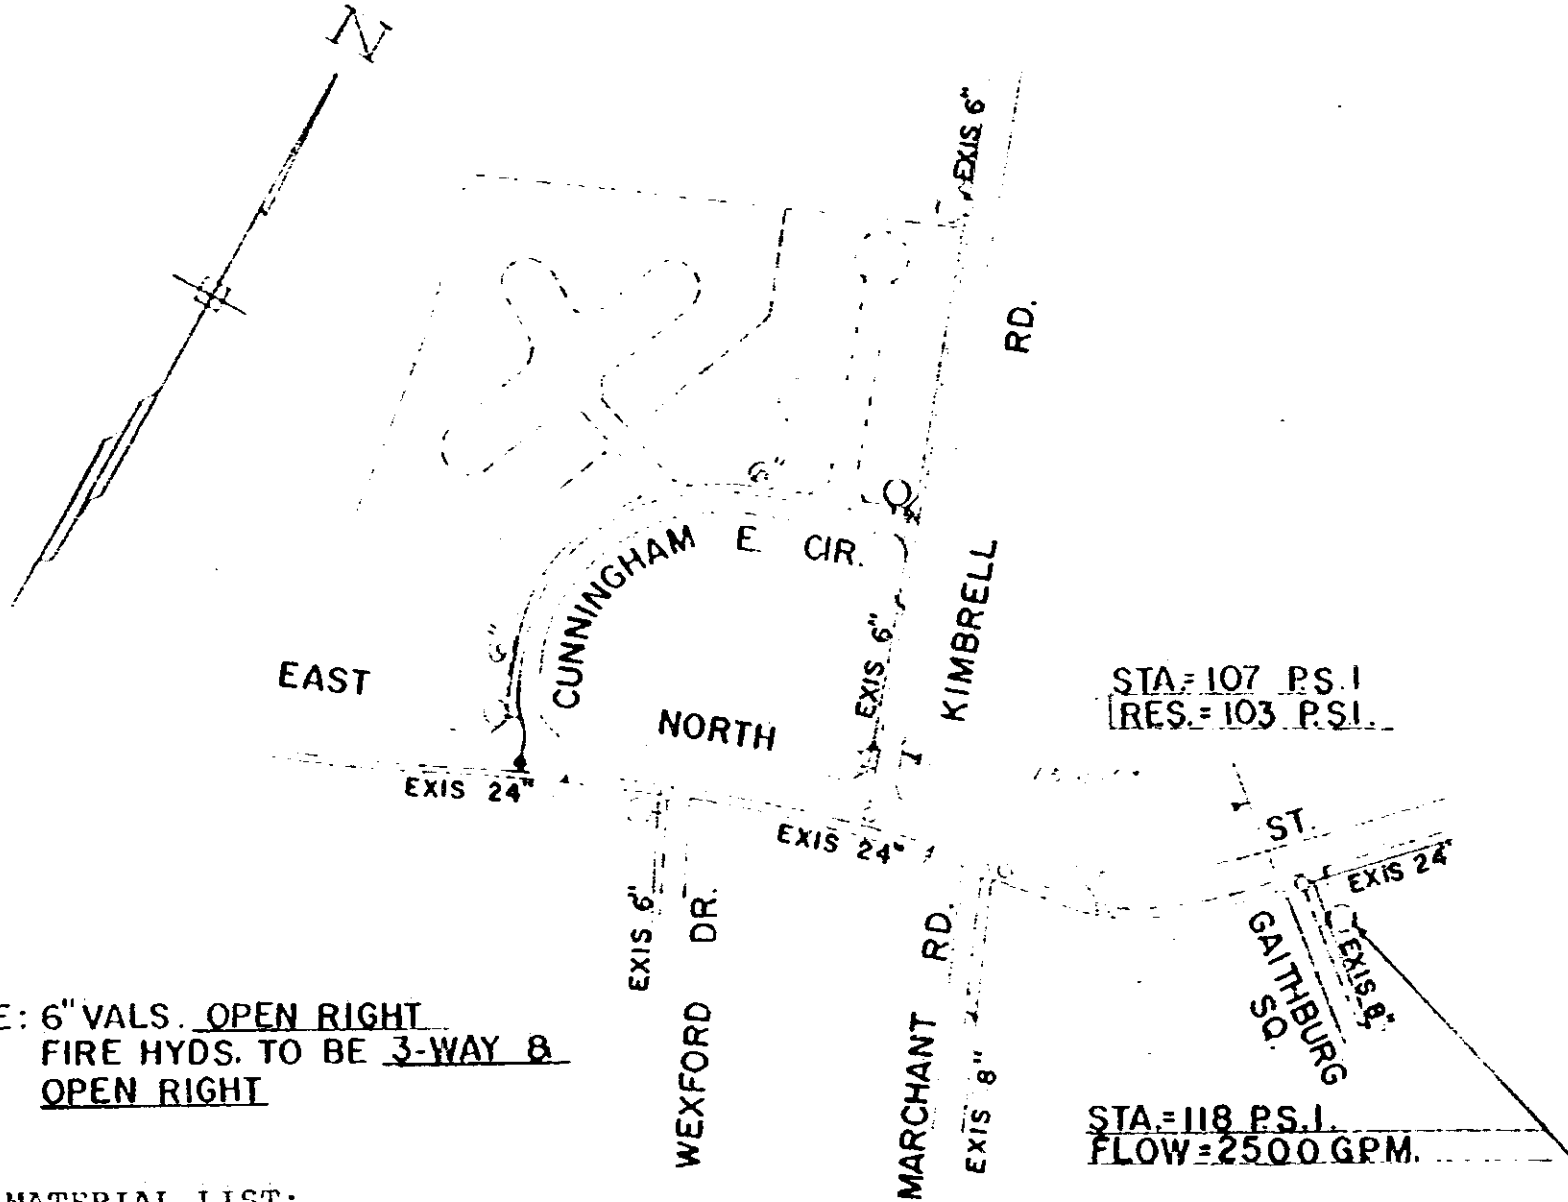

NOTE: 6" VALS. OPEN RIGHT
 FIRE HYDS. TO BE 3-WAY &
 OPEN RIGHT

MATERIAL LIST:

6" D. I. Pipe	-	1170'
6" Valves	-	4
Fire Hydrants	-	2
Valve Boxes	-	4

STA=107 P.S.I.
 RES.=103 P.S.I.

STA=118 P.S.I.
 FLOW=2500 GPM.

CUNNINGHAM EAST CIR.
 AUG. 1982 SCALE 1" = 400'

Sunbelt Properties, Inc.
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 November 17, 1982
 Blk. Book No. 538.1-1-32.3

RECORDED NOV 29 1982

at 2:38 P.M.

12914

4328 RV.2