


3070

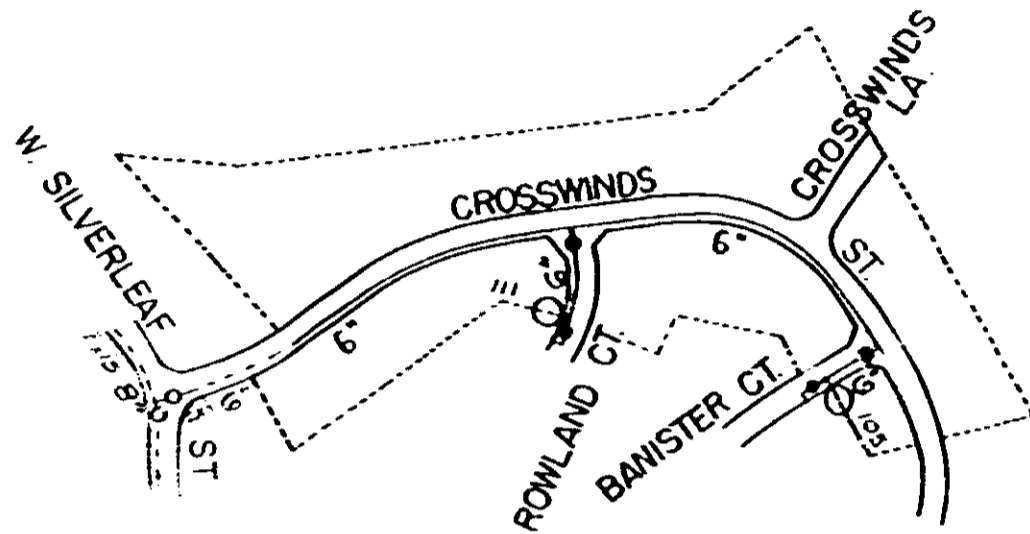

NOTE: 6" VALS. OPEN RIGHT, 2" VALS. OPEN LEFT, FIRE HYDS. TO BE 3-WAY & OPEN RIGHT.

MATERIAL LIST:

6" D. I. Pipe	-	1,575'
6" Valves	-	4
2" Valves	-	2
Fire Hydrants	-	2
Valve Boxes	-	6

American Service Corp.
 Greenville, S. C.
 to
 Commissioners of Public Works
 of the City of Greenville
 August 31, 1983
 Pt. of Blk. Book 538.7-1-13.2

RECORDED SEP 20 1983

at 3:39 P.M.

9436

SILVERLEAF SEC. I-B

DEC 1980 SCALE 1"=400'
 REVISED JAN., 1981
 REVISED AUG., 1983

9436-RV-21