


9529

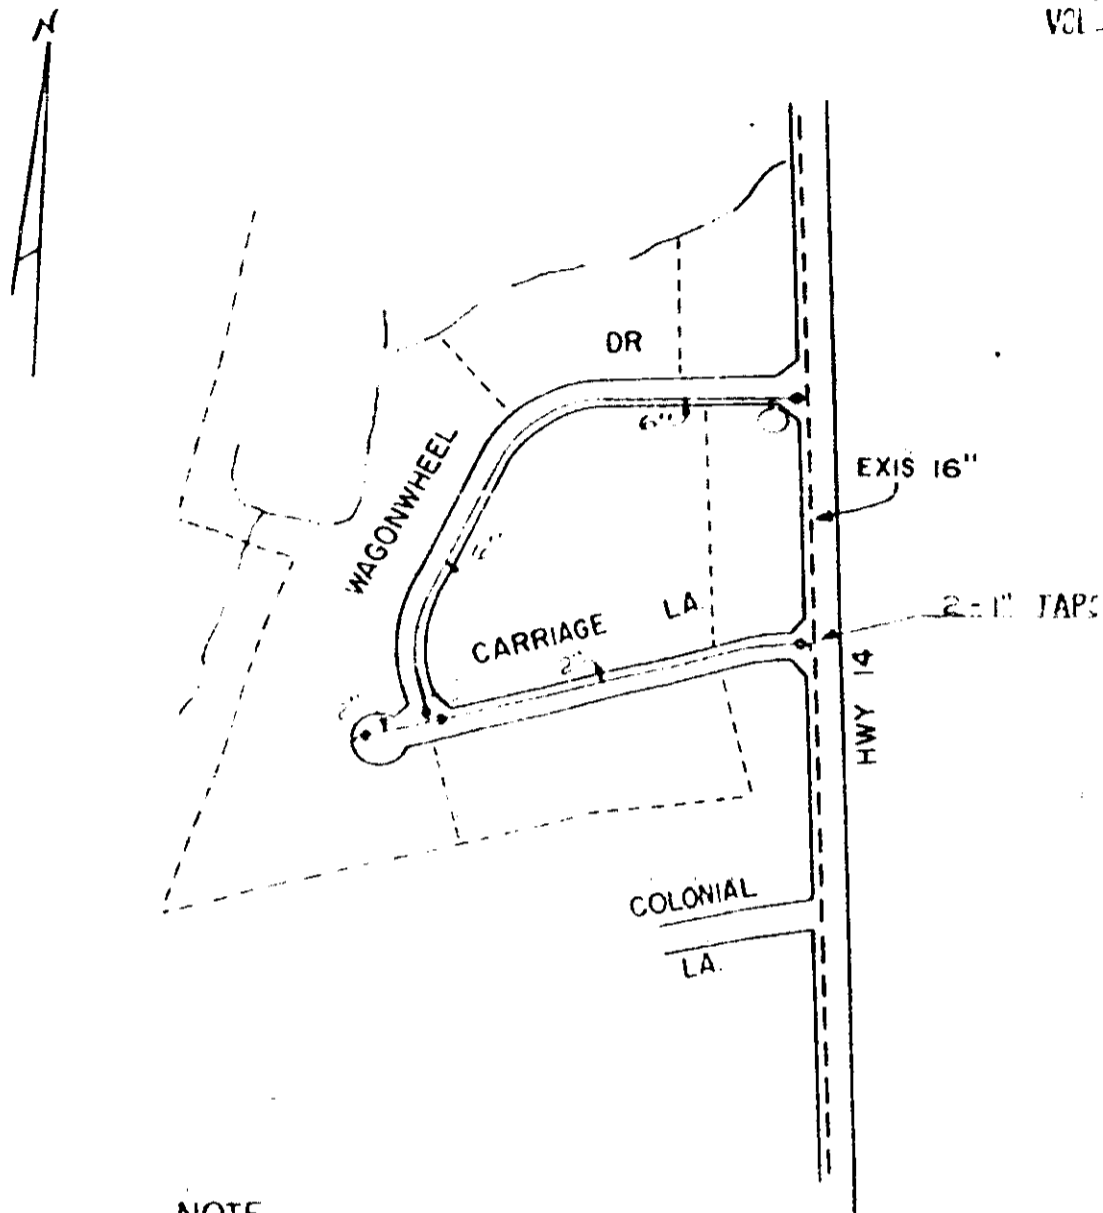

NOTE

ALL FIRE HYDRANTS ARE TO BE 3-WAY & OPEN RIGHT
 ALL 6" VALVES OPEN RIGHT
 ALL 2" VALVES OPEN LEFT

Material List.

6" C. I. T. J. Pipe	-	1135'
2" Galv. Pipe	-	925'
6" Gate Valves	-	3
Fire Hydrants	-	2
2" Brass Gate Valves	-	4

COLONIAL ACRES SEC. 2

JULY, 1974 SCALE 1" = 400'
 BLK BK 539.I-I-19.6

R. C. Ayers
 to

Commissioners of Public Works
 of the City of Greenville, S.
 March 24, 1975

RECORDED JUN 9 '75
 At 9:32 A.M.

28924

4328 RV-2J