


Vol 1088 Page 81

STATIC = 100 PSI  
FLOW = 750 GPM

STATIC = 90 PSI  
RES. = 30 PSI

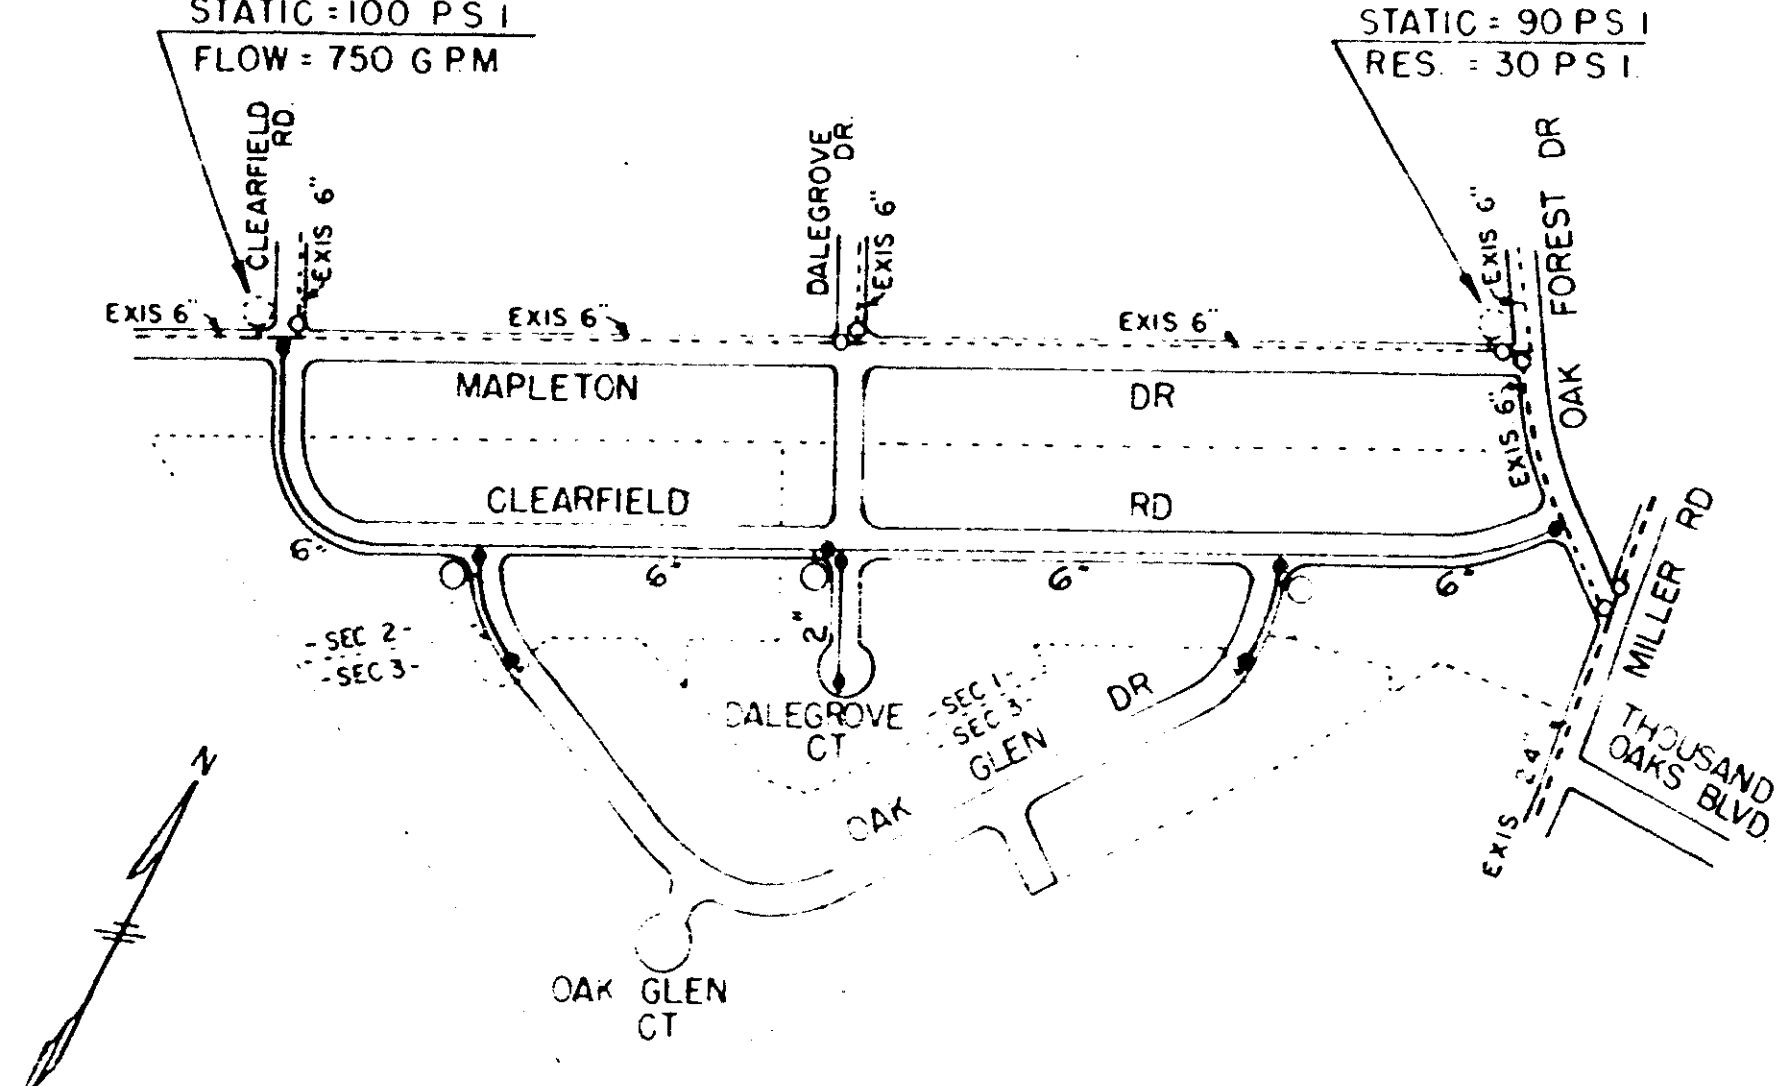

NOTE: ALL 6" & 2" VALVES TO OPEN LEFT  
ALL FIRE HYDRANTS TO BE 3-WAY  
& OPEN LEFT

MATERIAL LIST:

6" D. I. Pipe	2,700'
2" Galv. Pipe	2,400'
6" Valves	2
2" Valves	2
Fire Hydrants	2

OAK FOREST, SEC. 1, 2

MARCH, 1978 SCALE 1" = 400'

Prepared by: [unclear]  
 Checked by: [unclear]  
 Date: [unclear]  
 [unclear]  
 [unclear]

RECORDED 'AUG 24 1978

at 3:53 P.M.

6145

4328 RV-2

908