
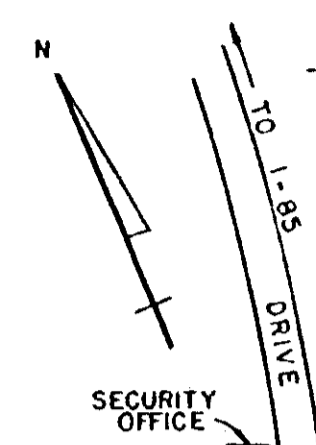


LUCAS INDUSTRIES, INC.

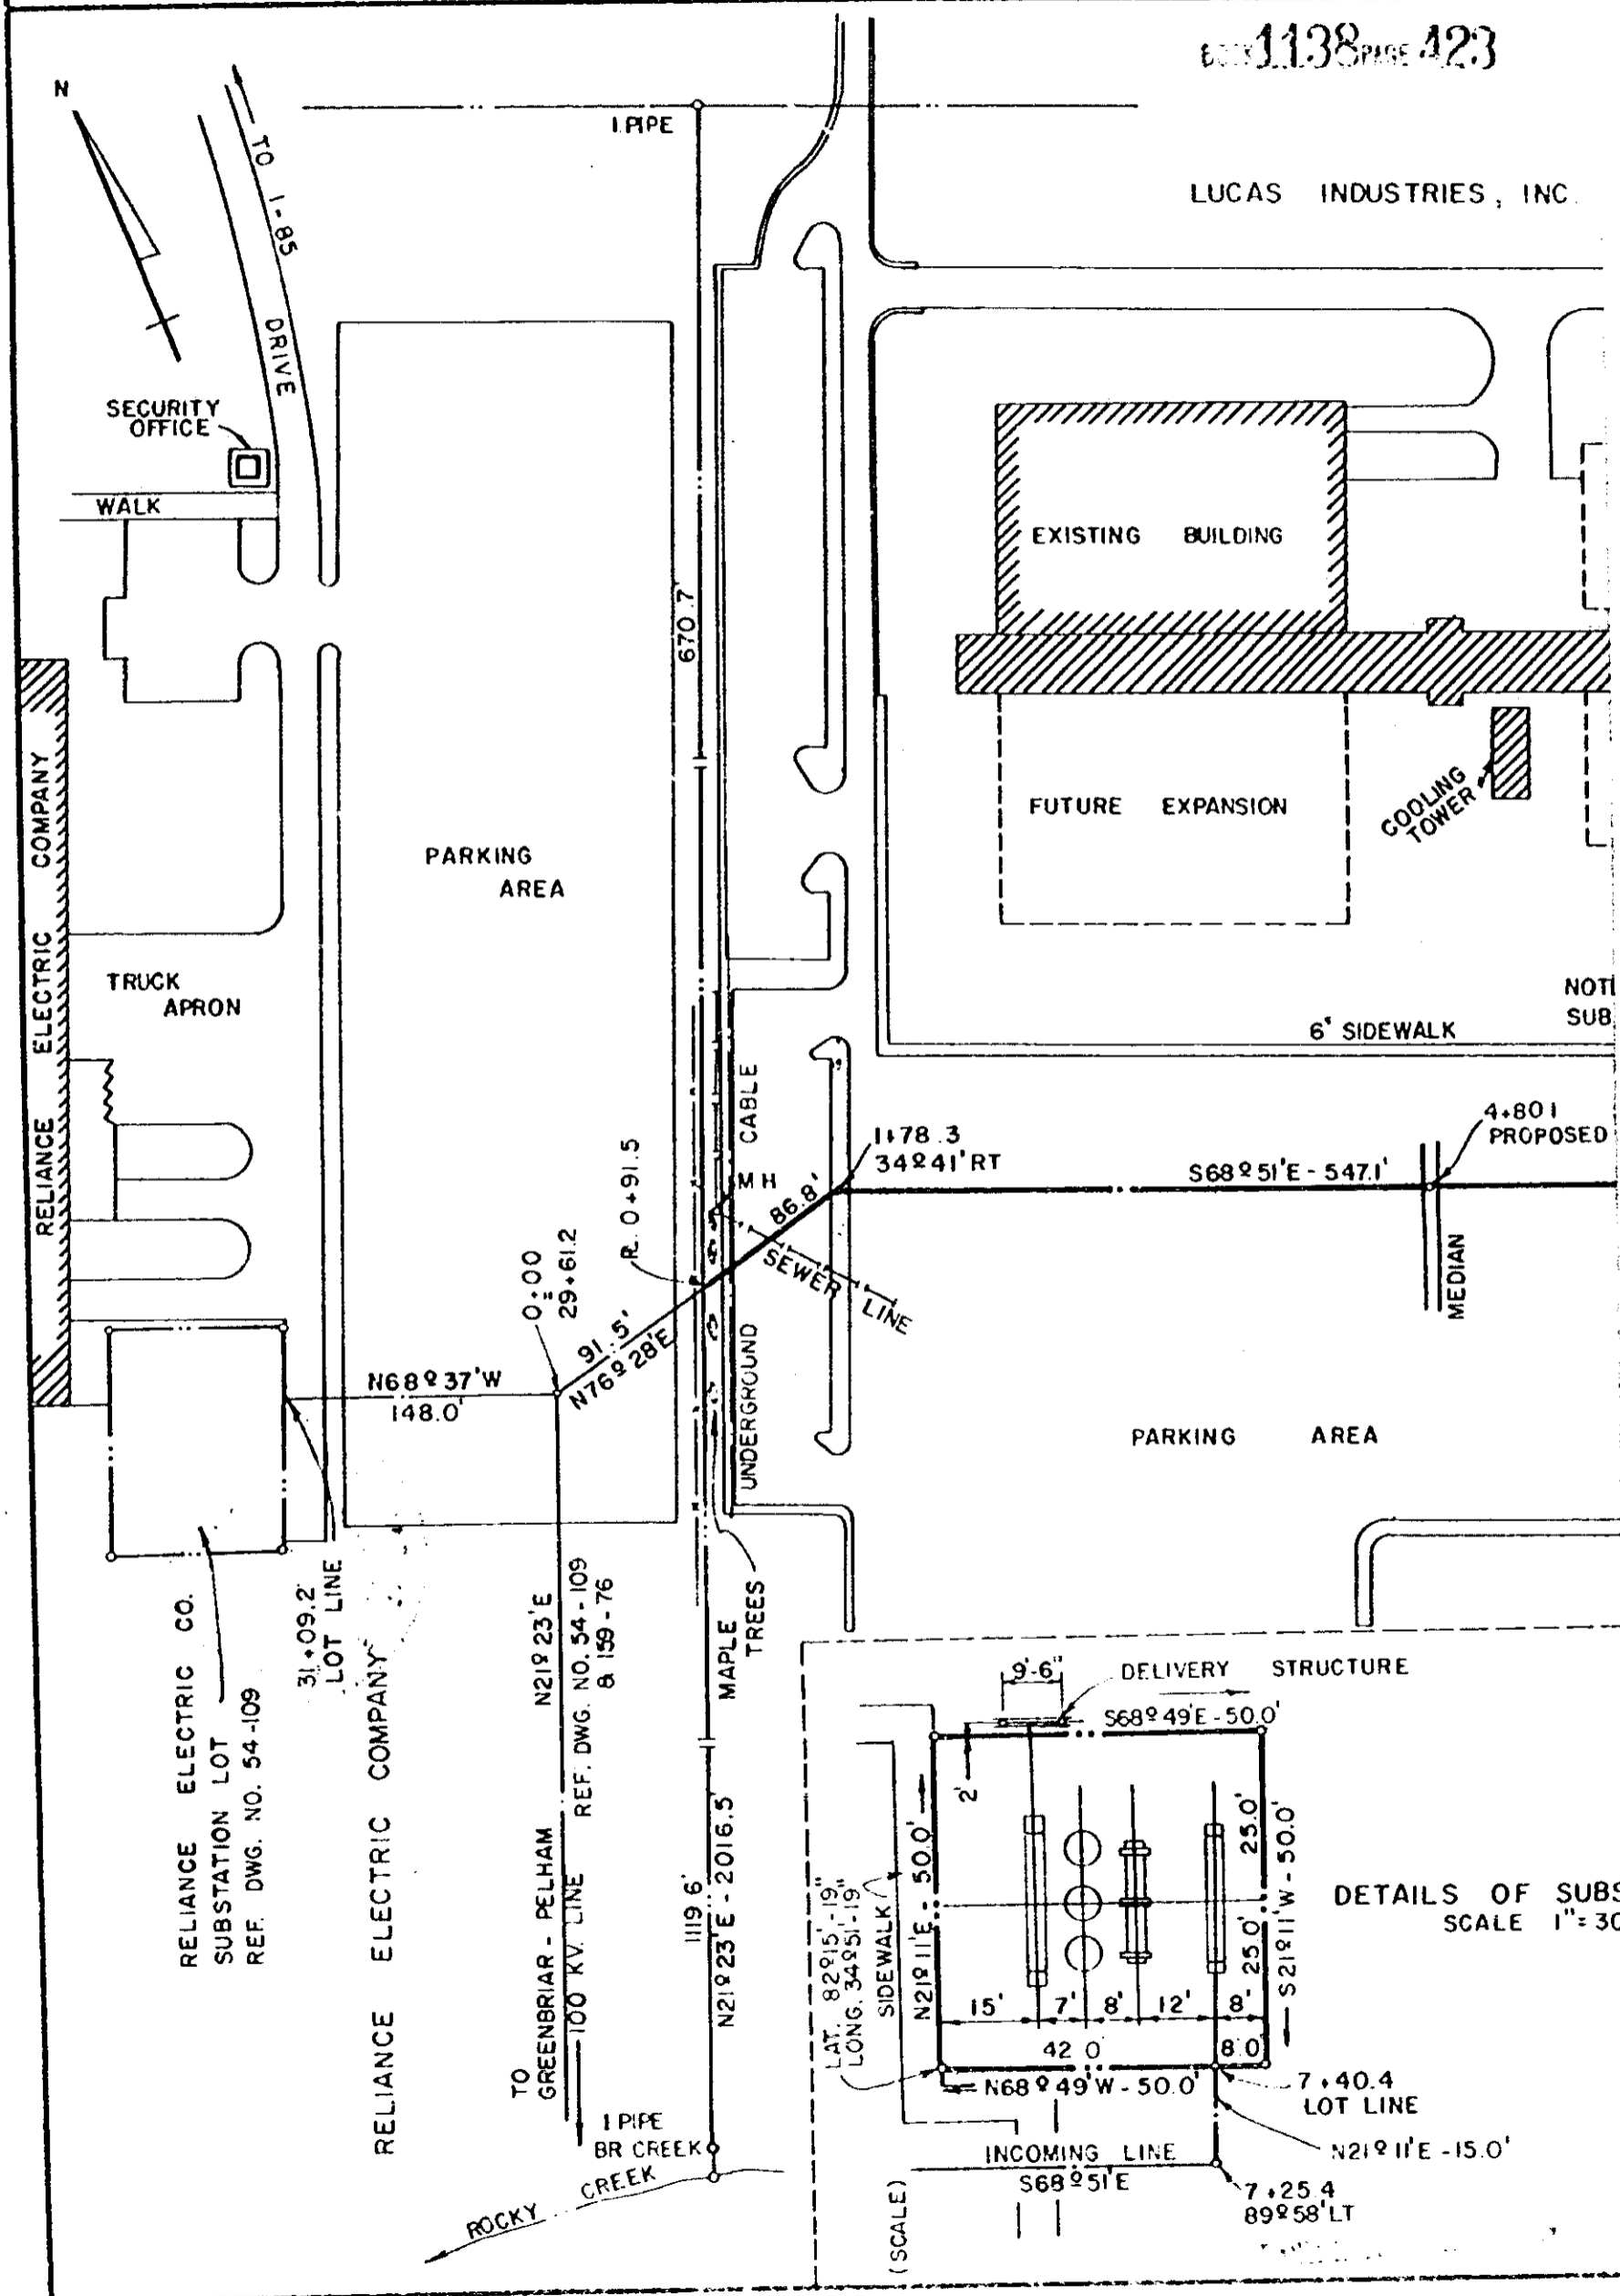

SECURITY OFFICE

WALK

RELiance ELECTRIC COMPANY

TRUCK APRON

PARKING AREA

EXISTING BUILDING

FUTURE EXPANSION

COOLING TOWER

6' SIDEWALK

NOT SUB.

1178.3
34241' RT

S68°51'E - 547.1'

4.801 PROPOSED

MEDIAN

UNDERGROUND CABLE

MH

SEWER LINE

PARKING AREA

RELiance ELECTRIC CO.
SUBSTATION LOT
REF. DWG. NO. 54-109

31.09.2'
LOT LINE

RELiance ELECTRIC COMPANY

N219°23'E
REF. DWG. NO. 54-109
& 159-76

TO GREENBRIAR - PELHAM
100 KV LINE

0+00
29+61.2

R. 0+91.5

N68°37'W
148.0'

N76°28'E

MAPLE TREES

1119.6'

N219°23'E - 2016.5'

TO ROCKY CREEK
I PIPE BR CREEK

DELIVERY STRUCTURE

S68°49'E - 50.0'

DETAILS OF SUBS
SCALE 1" = 30'

LAT. 82°15'-19"

LONG. 34°51'-19"

SIDEWALK

N219°11'E - 50.0'

15'

7'

8'

12'

8'

25.0'

25.0'

8.0'

42.0'

2

N68°49'W - 50.0'

7.40.4 LOT LINE

N219°11'E - 15.0'

INCOMING LINE

S68°51'E

7.25.4
89°58' LT

(SCALE)

0 4 2 3

4328 RV-2