


3  
0  
9  
0

BOOK 1147 PAGE 699

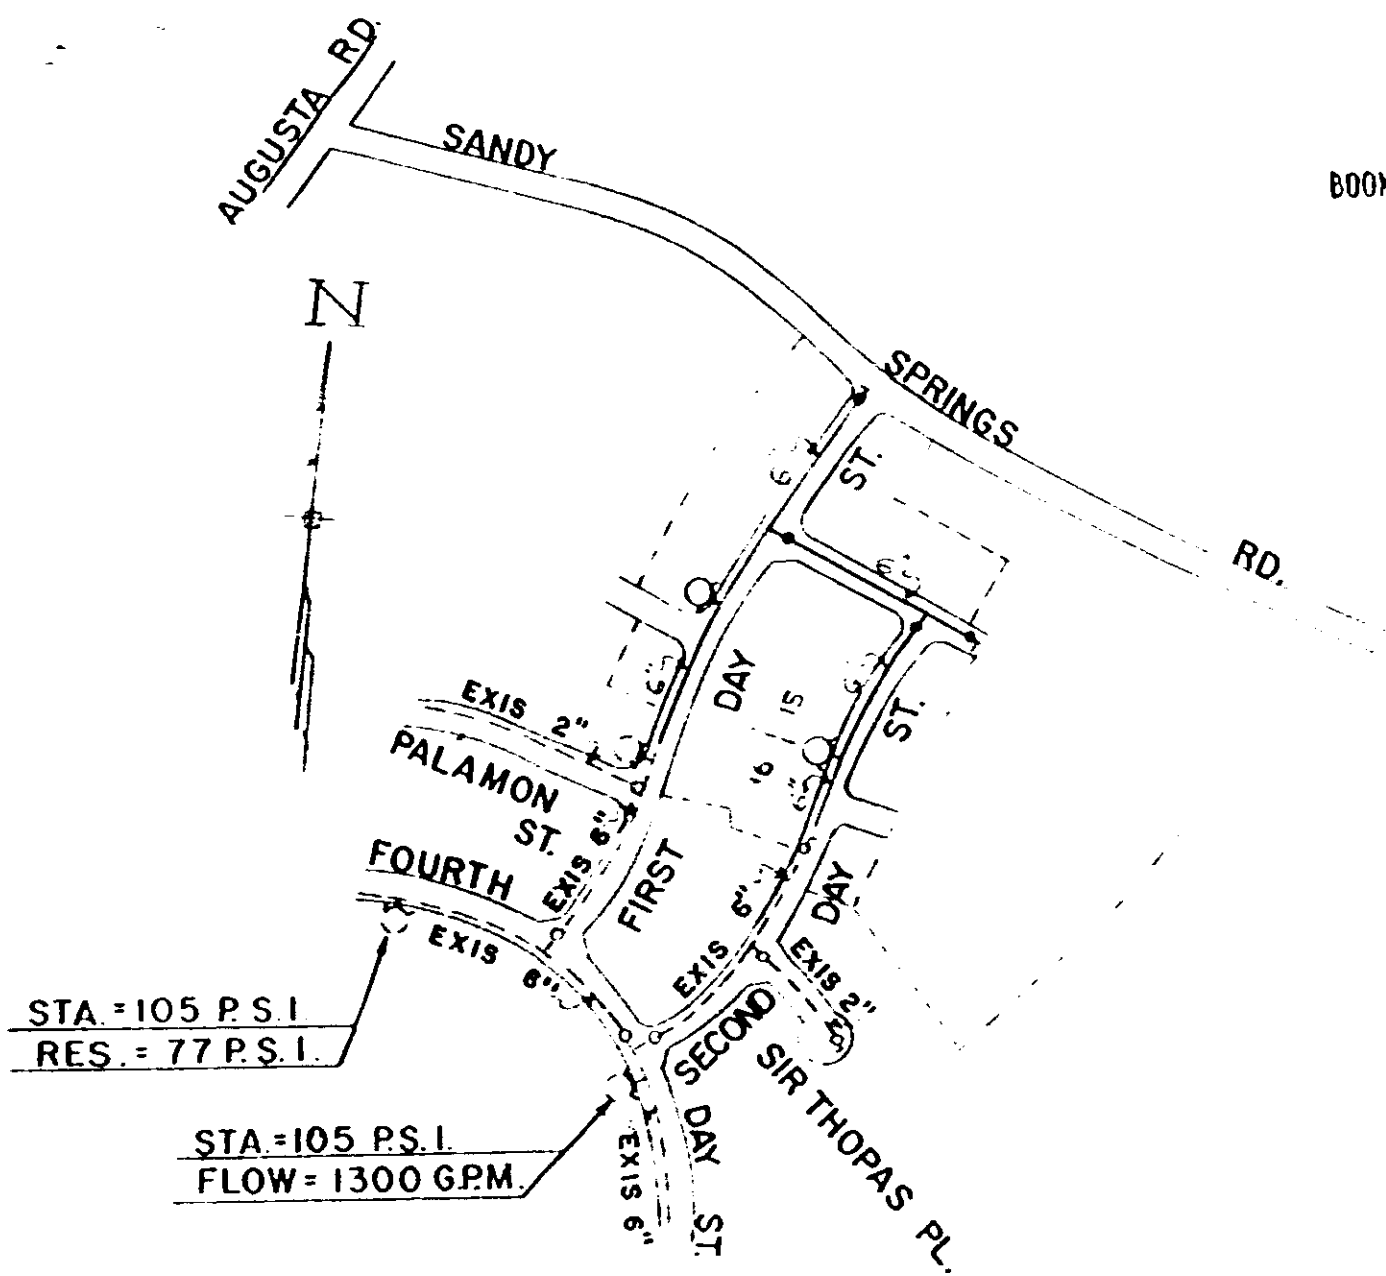

STA. = 105 P.S.I.  
RES. = 77 P.S.I.

STA. = 105 P.S.I.  
FLOW = 1300 G.P.M.

NOTE: ALL 2" VALS. OPEN LEFT  
ALL 6" VALS. OPEN RIGHT  
FIRE HYDS. TO BE 3-WAY & OPEN RIGHT

MATERIAL LIST:

6" D. I. Pipe	-	1,830'±
6" Valves	-	4
2" Valves	-	2
Fire Hydrants	-	2

CANTERBURY SUBD SEC. III PH. A

DEC. 1980 SCALE 1" = 400'

*The Fortis Corporation* ~~The Fortis Corporation~~  
to

Commissioners of Public Works  
of the City of Greenville, S. C.  
April 8, 1981  
Block Book Pt. of 602.3-1-65  
31257

RECORDED: **MAY 8 1981**  
at 1:23 P.M.

4328 RV-2