


BOOK 1148 PAGE 915

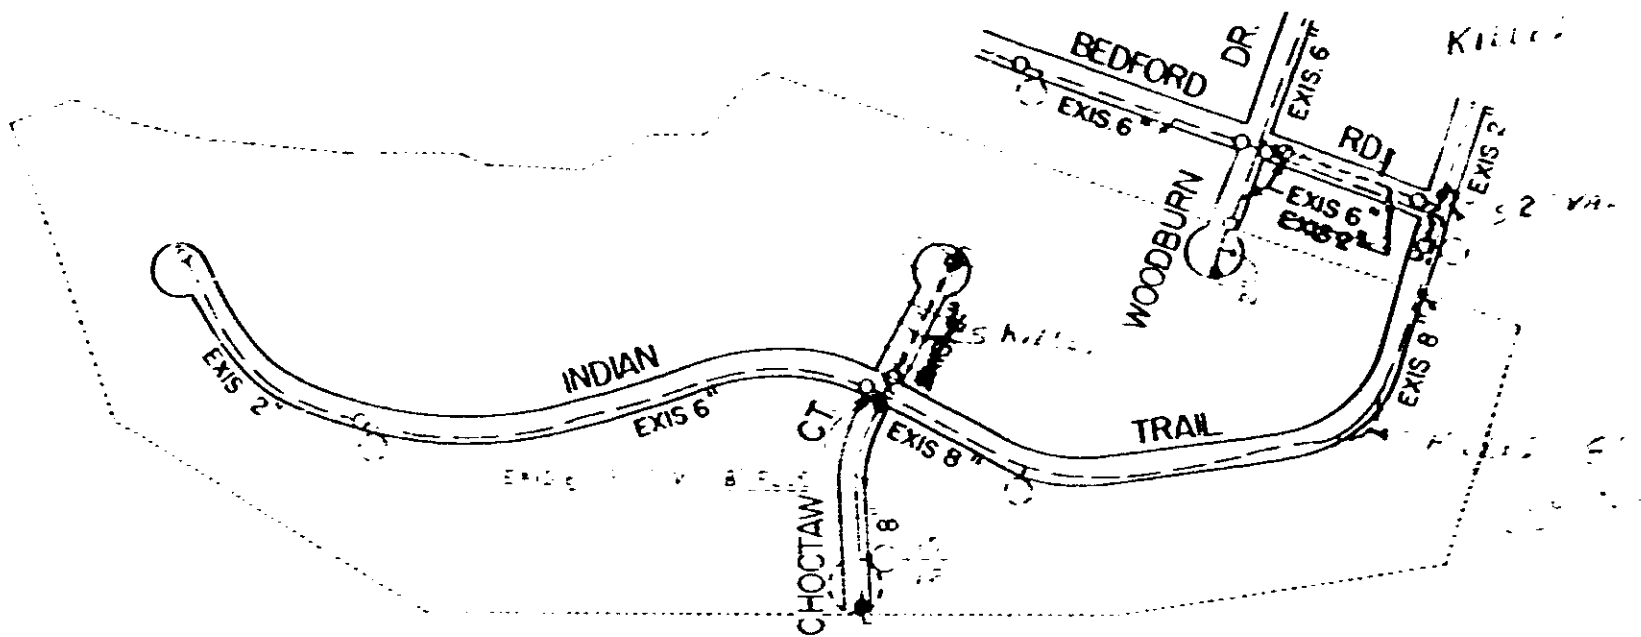

0915

NOTE 6" & 8" VALS OPEN RIGHT, 2" VALS. OPEN LEFT, FIRE HYDRANT TO BE 3-WAY & OPEN RIGHT

MATERIAL List:

8" D. I. Pipe	-	430'±
2" Galv. Pipe	-	110'±
8" Valve	-	1
2" Valves	-	2
6" Valve	-	1
Fire Hydrant	-	1

✓ The Fortis Corporation
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 April 23, 1981
 BLK. Book T29.4-1-9, 10, 11 &
 Pt. of 29, 31 & 32

*Voided - Combined with T29.4-1-3
for 1981*

RECORDED **MAY 28 1981** at 12:27 P.M.

FOREST ACRES
NOV 1980 SCALE 1"=400'

32959

4328 RV-2