


BOOK 1150 PAGE 844

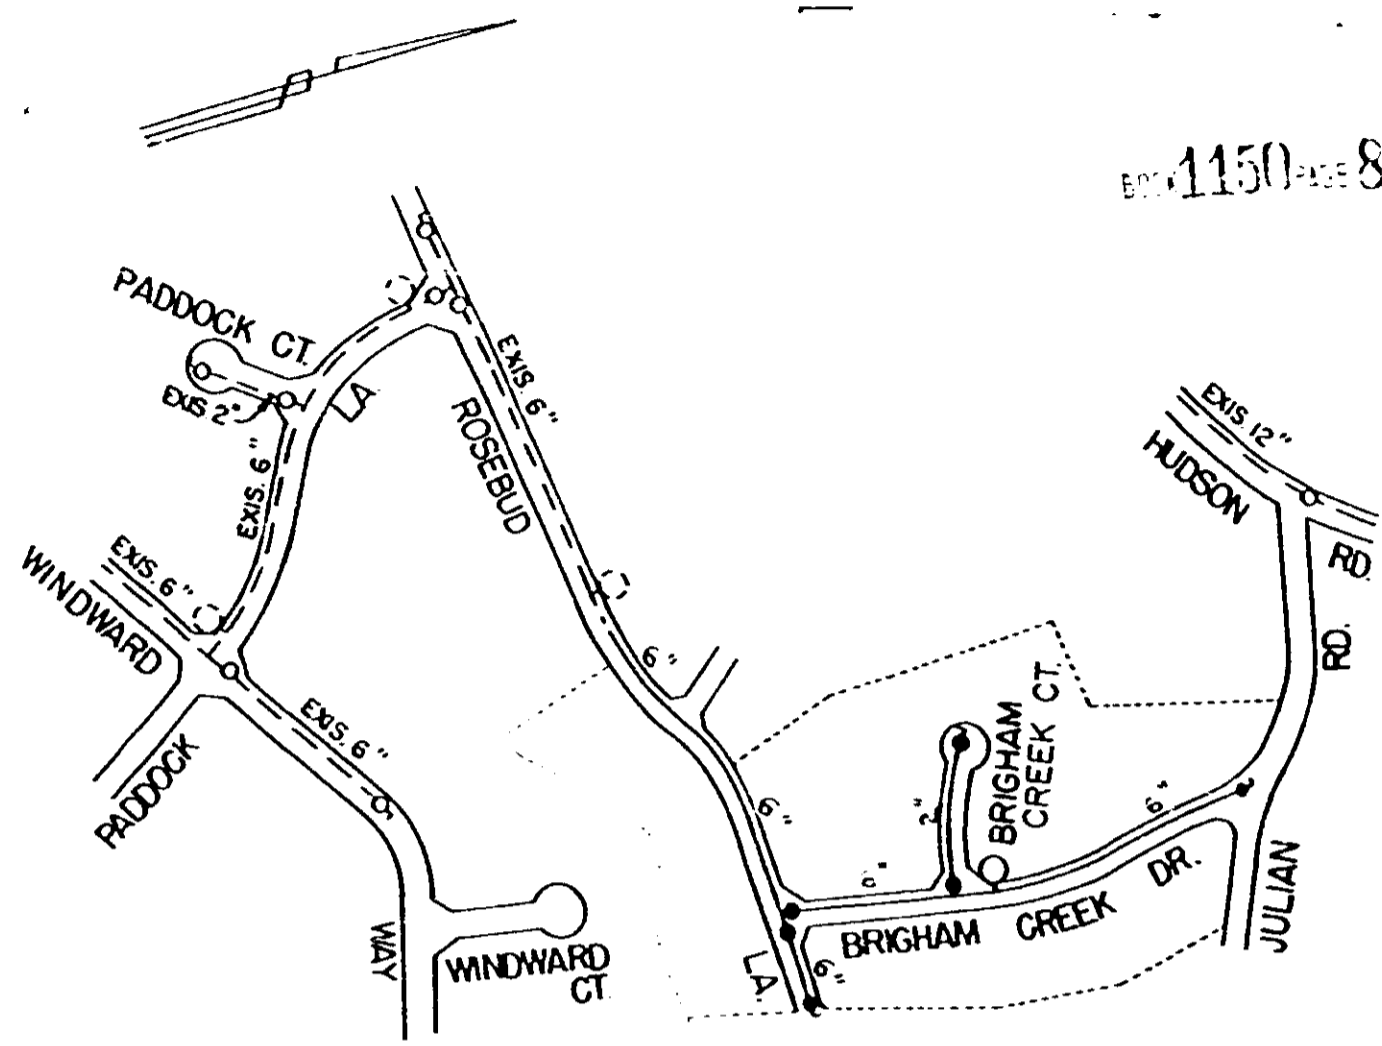

NOTE: 6" VALS. OPEN RIGHT, 2" VALS. OPEN LEFT, FIRE HYDS. TO BE 3-WAY & OPEN RIGHT.

Material List:

6" D. I. Pipe	-	1,740'±
2" Galv. Pipe	-	320'±
6" Valves	-	3
2" Valves	-	4
Fire Hydrant	-	1

College Properties, Inc.  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 May 20, 1981  
 Pt. of BLK. BOOK 540.3-1-9.5

RECORDED JUN 30 1981  
 at 11:37 A.M.

DEVENGER PLACE SEC. 13  
 MAY, 1981 SCALE 1" = 400'

36196

0844

4328 RV-2