


VEL. 1226 P. 635

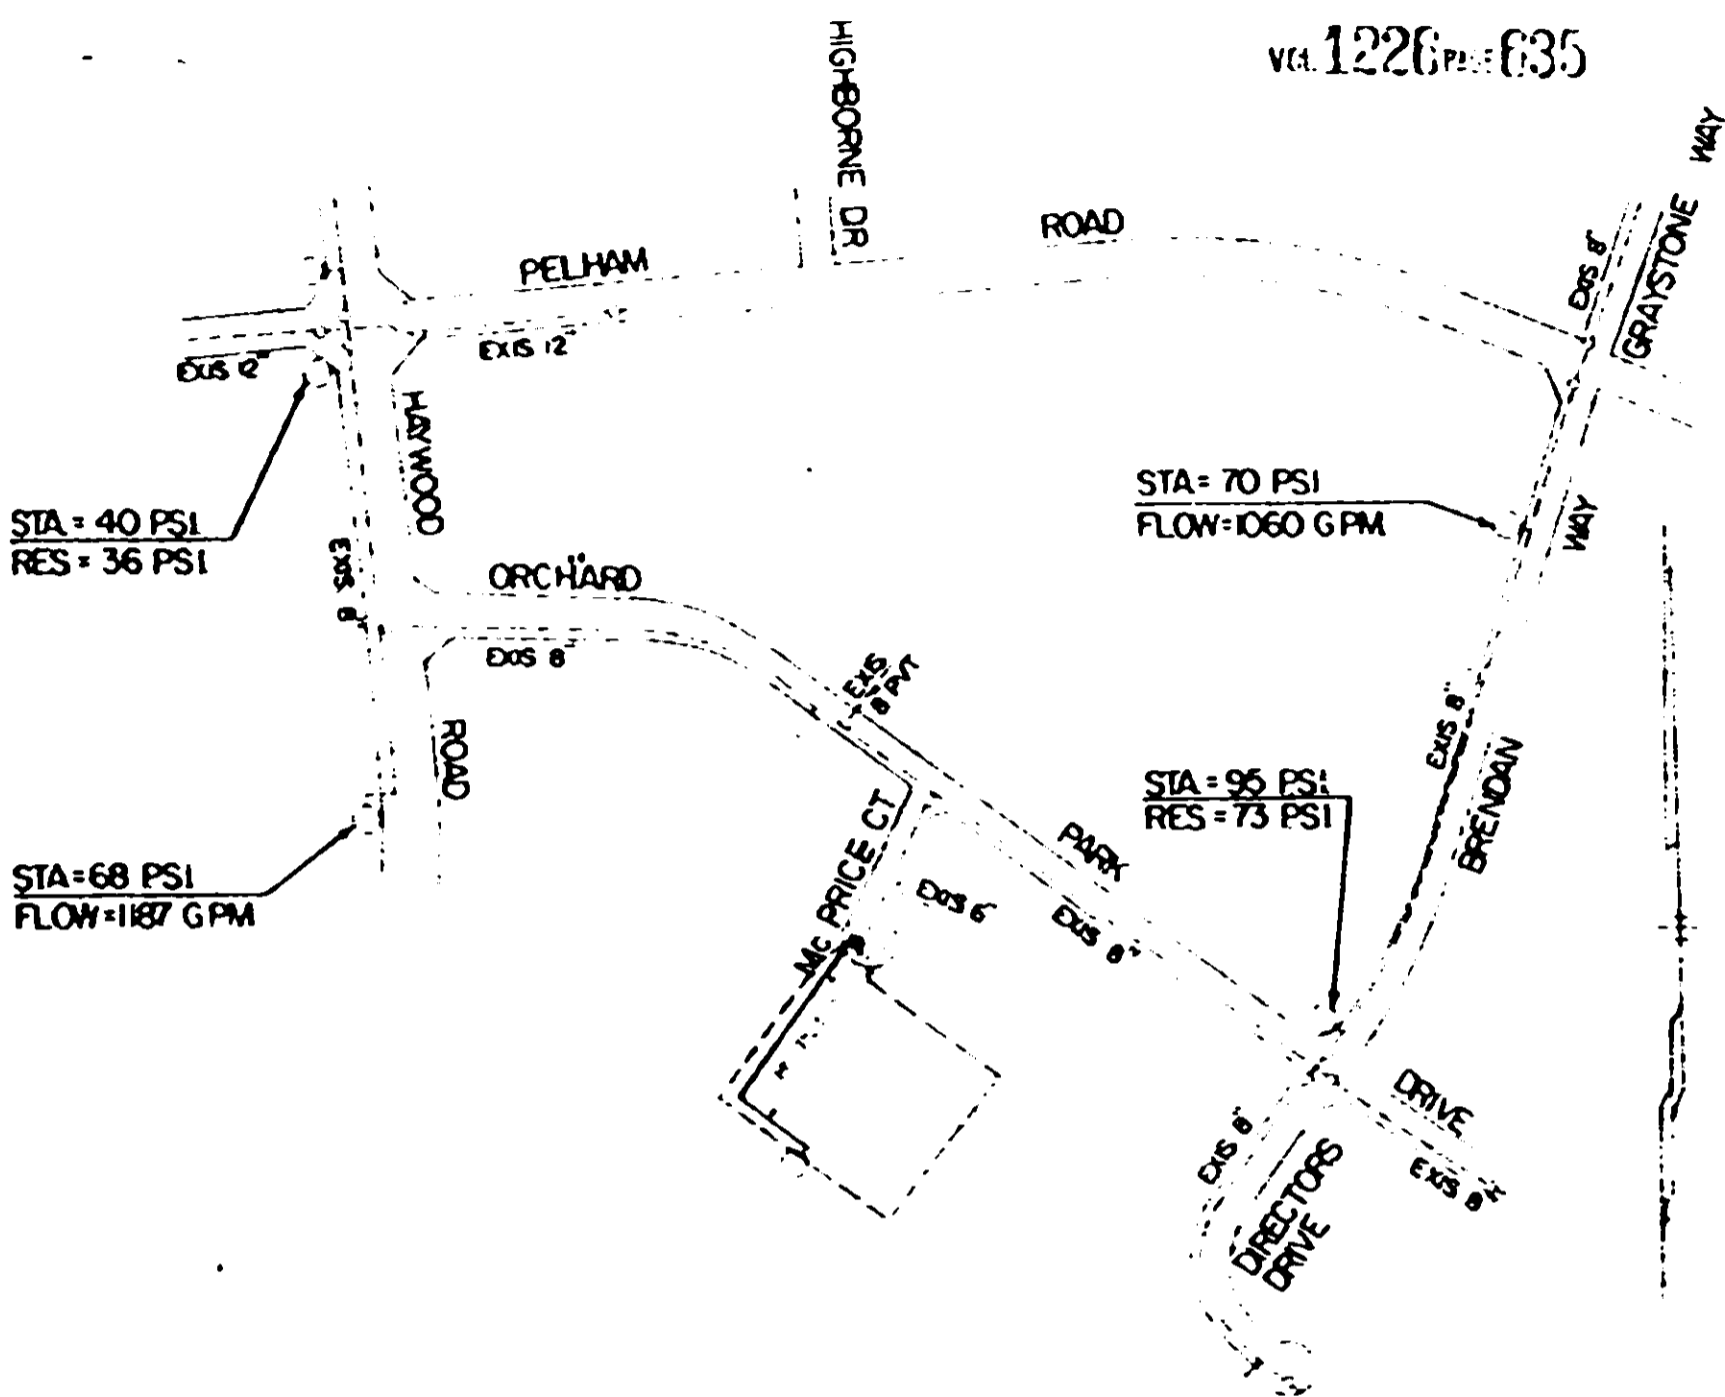

STA = 40 PSI
RES = 36 PSI

STA = 70 PSI
FLOW = 1060 GPM

STA = 68 PSI
FLOW = 1187 GPM

STA = 95 PSI
RES = 73 PSI

NOTE 6" 8" VALVES OPEN RIGHT
FIRE HYDRANT TO BE
3-WAY 8" OPEN RIGHT

✓ EASEMENT
Beacon Properties 184, Ltd.
to
Commissioners of Public Works
of the City of Greenville, S. C.
November 1, 1984
Block Book 543.3-1-62

RECORDED NOV 16 1984 at 2:46 P.M.

15931

BROCK RESIDENCE INN
JULY, 1984 SCALE 1" = 400'

0630

0630